




ENGINEERING DEPARTMENT
STANDARD DETAILS

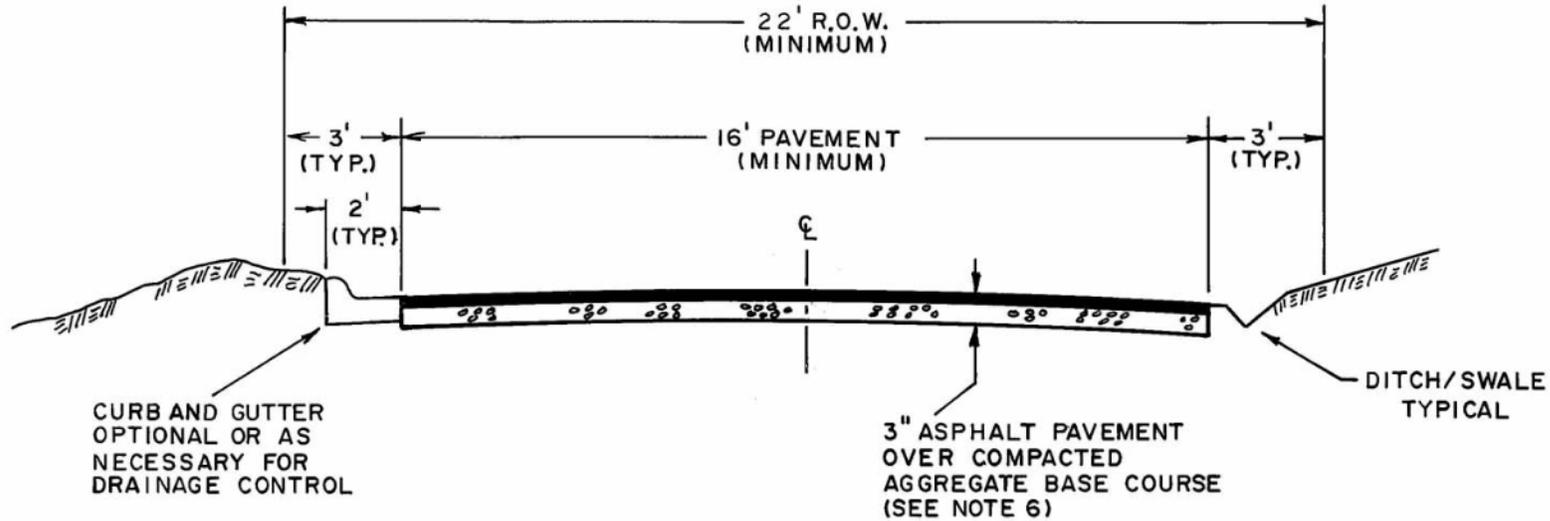

NOTES:

1. 16' PAVEMENT WIDTH REQUIRED FOR PUBLIC MAINTENANCE OF ALLEY.
2. INVERTED CROWN MAY BE CONSIDERED BASED UPON SPECIFIC DESIGN PROPOSALS.
3. 30" CURB AND GUTTER MAY BE REQUIRED BASED UPON SPECIFIC DESIGN PROPOSALS.
4. ALTERNATIVE PAVEMENT DESIGNS MAY BE REQUIRED BASED UPON SITE-SPECIFIC SOIL AND DRAINAGE CONDITIONS.
5. ADDITIONAL RIGHT-OF-WAY MAY BE REQUIRED FOR UTILITY INSTALLATIONS.
6. AGGREGATE BASE COURSE THICKNESS SHALL BE 8" IN TYPE I AREA ; 10" IN TYPE II AREA.

NO SCALE

TITLE :
PUBLIC ALLEY

REVISIONS		
NO	DATE	BY

DET.NO.
ST-IF
SH. 7 of 8